DATE: 04.11.16



Performance Criteria: Sound Insulation

Applicable Standards: BS EN ISO 10140-2: 2010; ISO 717-1:1996

System: Optima 36

Configuration: Single glazed in 12mm Toughened

Description: Glazed screen comprising multiple modules of 12mm toughened glass installed

into 36mm wide aluminium track sections with glass sealed into tracks with PVC

gaskets and between panels with Optima dry-joints.


Test Date: 30.11.11

Test Report Number: 542-434 supported by 2916-2502 & 2503 (see Performance Certificate 036035)

Test Specimen Area: 8.64m²

Test Data:

| Frequency (Hz) | R (dB) screen | R (dB) door |
|-------------------|------------------|----------------|
| 100 | 27.4 | ~ |
| 125 | 27.2 | ~ |
| 160 | 28.0 | ~ |
| 200 | 28.6 | ~ |
| 250 | 29.4 | ~ |
| 315 | 30.8 | ~ |
| 400 | 33.0 | ~ |
| 500 | 34.9 | ~ |
| 630 | 34.3 | ~ |
| 800 | 34.0 | ~ |
| 1000 | 27.2 | ~ |
| 1250 | 26.3 | ~ |
| 1600 | 30.0 | ~ |
| 2000 | 33.4 | ~ |
| 2500 | 37.5 | ~ |
| 3150 | 39.9 | ~ |

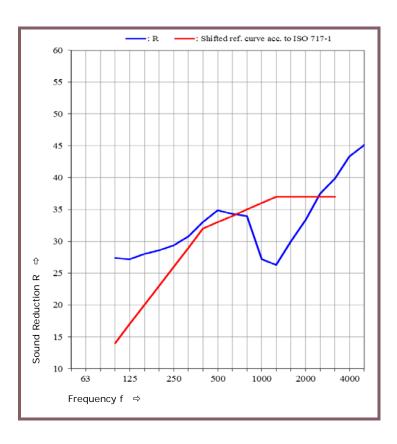

Third Octave Band

Weighted Sound Reduction Index

 R_w (C;Ctr)

33

(-2;-3)

dB

Independently tested at UKAS accredited acoustic test laboratory

Issued By:

Position:

Technical Manager

To validate this certified performance the system installation must be carried out in strict accordance with the details summarised in the Optima Designer's Guide and Installer's Guide.

Title: Sound Insulation – 12mm Toughened

Ref: 036036